City of Springfield
Water Pollution Control Section
Pollution Complaint/Report Form

Date 11/4/91

Report From:
[X] Citizen Ray Morris EDGE Supply
[ ] Fire Dept.
[ ] Public Information Office
[ ] Health Department
To [X] Other ED SEARS - DNR

Received By: R. CYMAN
Referred To: B. CORSON
Date of Incident:

Complainant Information:
Name Ray Morris - EDGE Supply
Address 1605 N. BOONVILLE
Phone 862-7083

Responsible Party Information:
Name
Address
Phone

Directions (if needed):

Possible contamination of: [?] soil [?] groundwater
[ ] surface water what body?
[X] other SANITARY SEWER

Other pertinent information:

Who to contact: 845

[ ] DNR 417-~~837~~-6950
[ ] DNR 314-634-2436
[ ] EPA 913-236-3778
[ ] Fire Dept. 864-1719
[ ] Police Dept. 864-1719
[ ] Bob Schaefer
[ ] CU 831-8320
[ ] Street Dept.
[ ] Health Dept.
[ ] Sewer Maintenance
[ ] Sewer Construction
[ ] Chemtrec 1-800-424-9300
[ ] DOT
[ ] NRC 1-800-424-8802
[ ] Other

Details of incident: GASOLINE ODORS IN DRAIN AGAIN. ED SEARS CONTACTED DAVE FRALEY & DUANE GALLOWAY AT C.U.

Action needed: FOLLOW OUR PROCEDURE FOR GASOLINE IN SEWERS.

(over) ADDRESS

1605 N. Boonville

Investigation Results

I met the fire department and personnel from C.U. at Edge Supply (11:00 AM). Using the exotox detector I recorded no elevated readings from the floor drain in the building or the sewer manhole adjacent to the building.

It should be noted that C.U. was repairing some underground storage tanks which are next to the sewer line.

Mr Morris indicated that this was a recurring problem over the last several years.

11-28-90

Memo to File

Re: Gasoline Smell in Edge Supply - 1605 N. Boonville

At approximately 3:00 P.M. on 11-28-90 we received a complaint that Edge Supply had a gasoline odor in the building. Karen Chandler & I checked the following M.H.'s an obtained 0 % LEL.

WYE Map K-10

M.H. 3 (Slight Gasoline Smell)

WYE Map . K-9

M.H. 71 (Slight Gasoline Smell)

M.H. 70 " " "

M.H. 42 " " "

M.H. 41 (No Smell)

We went to Edge Supply and talked to Ray. He showed us the drain. When he first smelled the gasoline, the trap was dry. After putting water in the trap the smell left. We pulled the cover on the D trap and could immediately smell gasoline. We told Ray to put tape over the drain to be safe, even though the smell left when he put water in it. He stated that he could just put a plug in the drain because the drain is never used. We told him that would be great because it would solve the problem of his trap going dry. He said the smell first started when C.U. Bus Barn received a shipment of gasoline. We told him we would talk to

C.U.

We went to C.U. Bus Barn and talked to them. They have had no problems that they know of. They have not smelled any gasoline and have not dumped anything.

We checked the following M.H.'s again and obtained 0 % LEL.

WYE Map K-10
M.H. 3
WYE Map K-9
M.H. 70
M.H. 42
M.H. 41

We will check the area again tomorrow.

Gene Pabst

11-29-90 Karen & I checked the following M.H.'s with 0% LEL & No smell (2:00 P.M.)
Wye Map K-9 M.H. 70
Wye Map K-10 M.H. 3

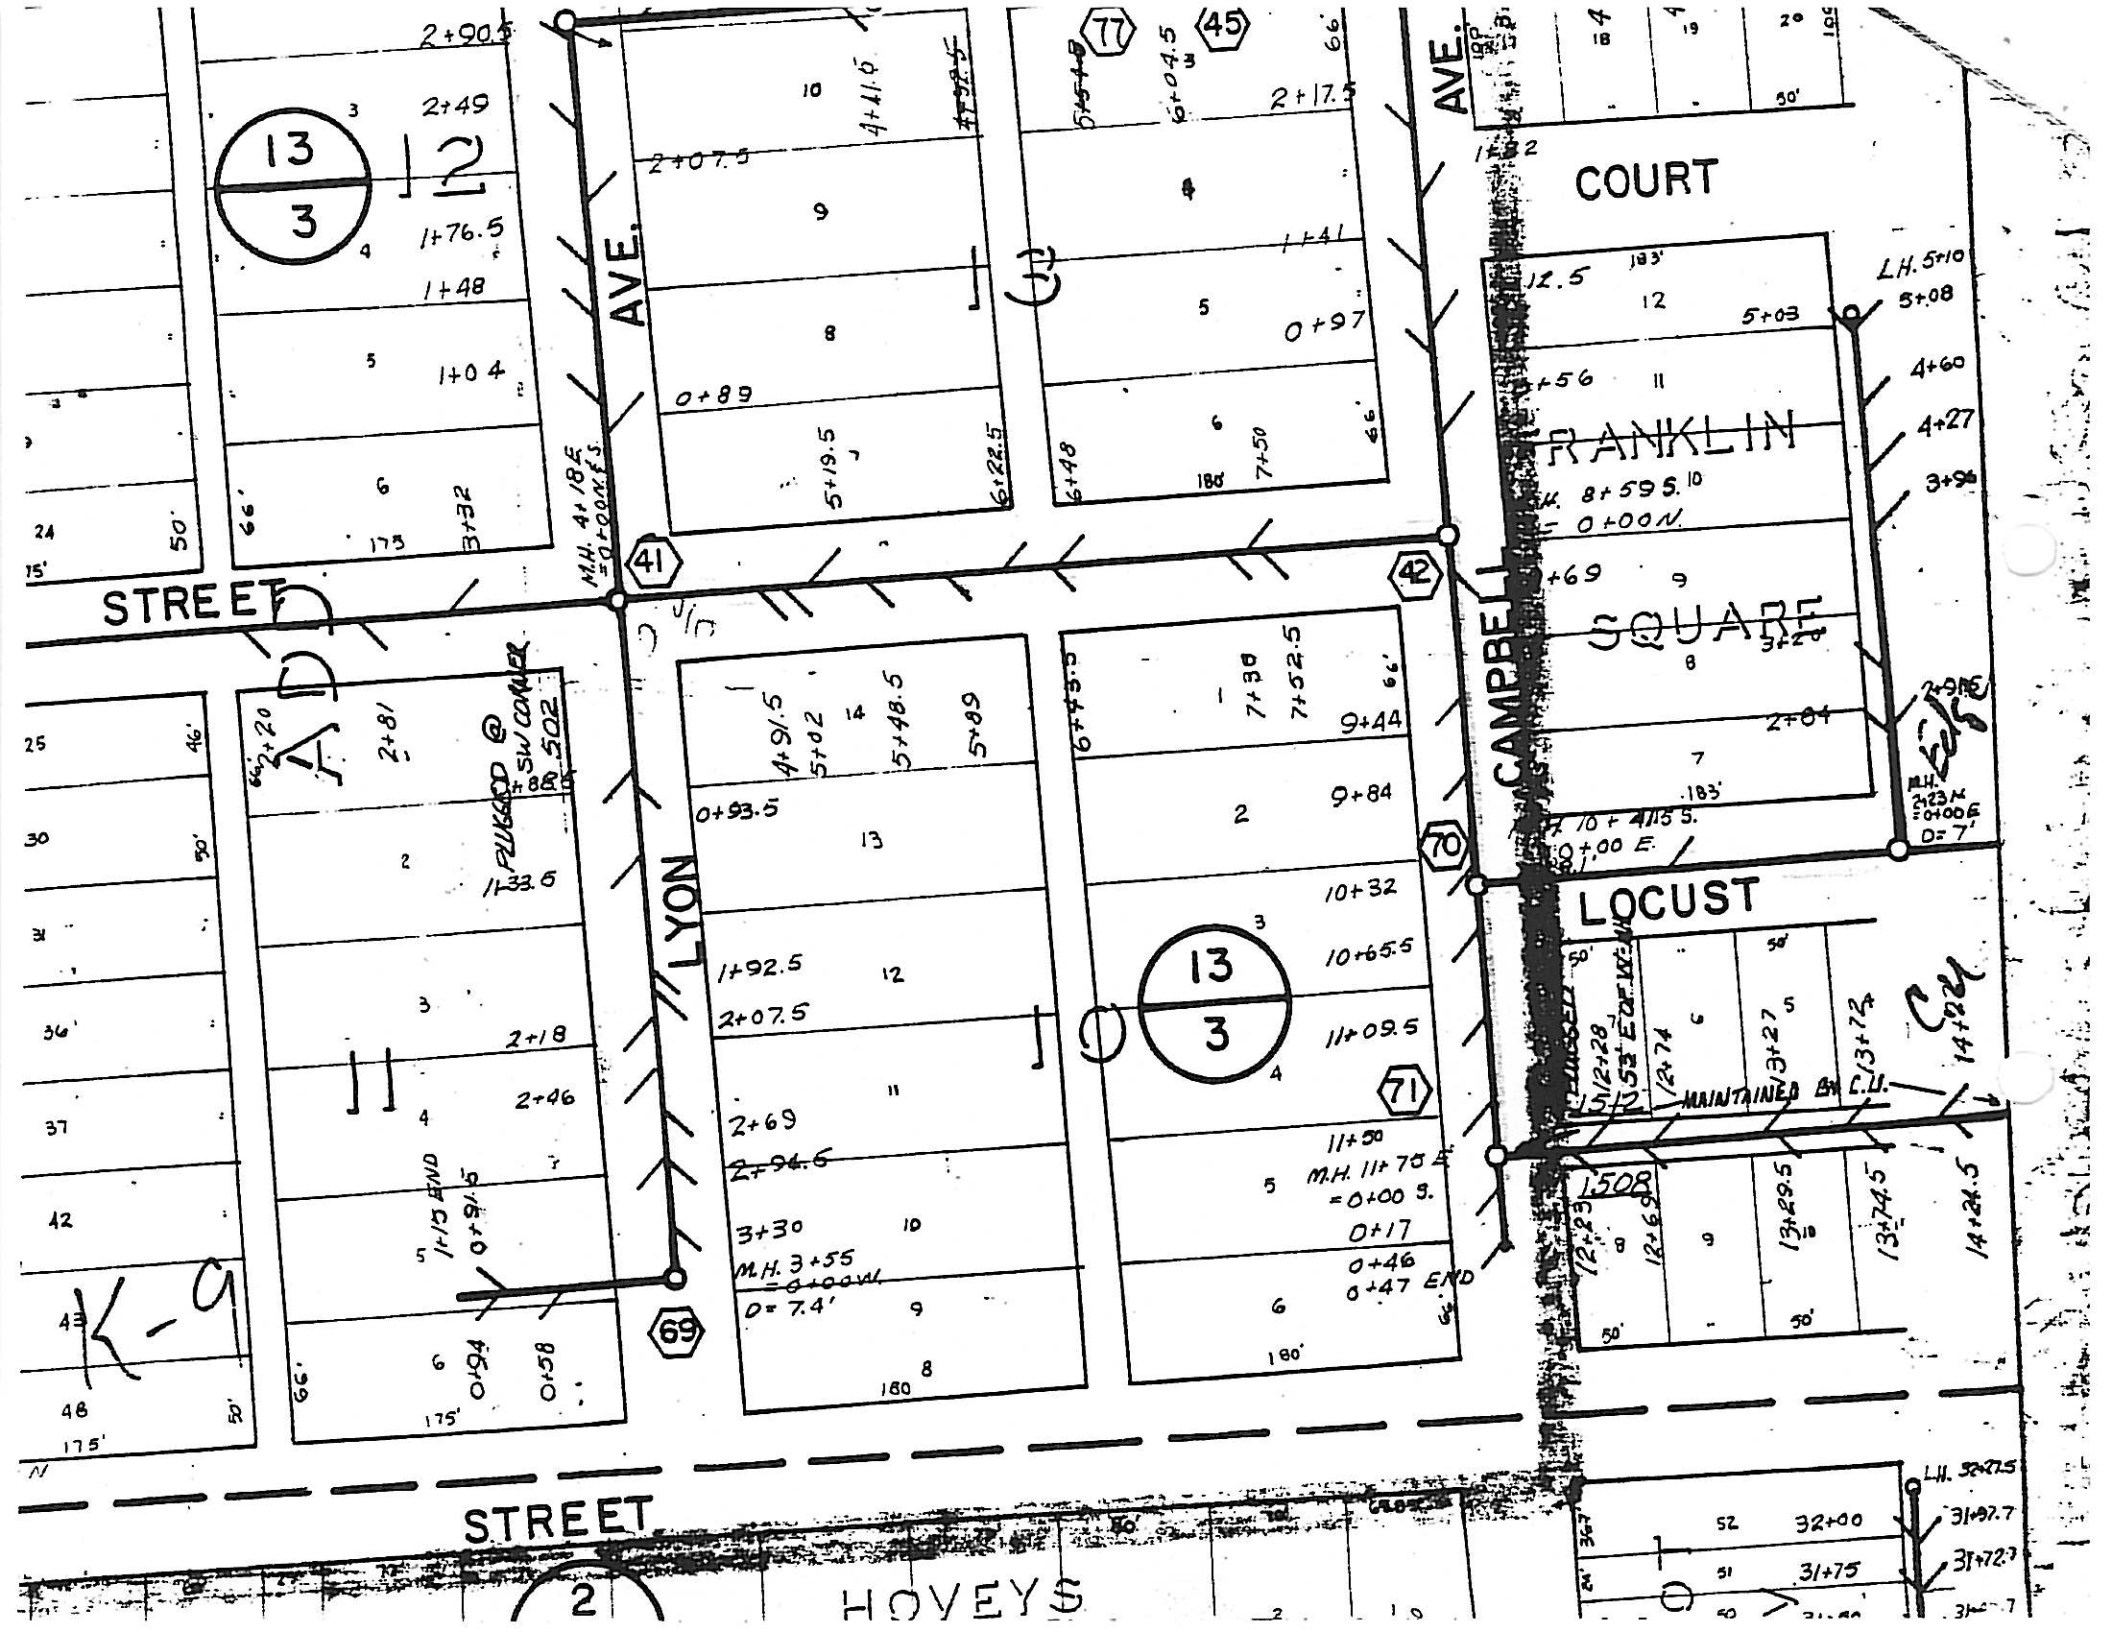

COURT
FRANKLIN
SQUARE
LOCUST
CAMPBELL
AVE.
LYON
AVE.
STREET
STREET
HOVEYS
MAINTAINED BY C.U.
PLUGGED @ SW CORNER 502
M.H. 4+18 E. =0+00 N. & S.
M.H. 3+55 =0+00 W. D= 7.4'
M.H. 11+75 E. =0+00 S.
M.H. 2+23 N. =0+00 E. D= 7'
K-9

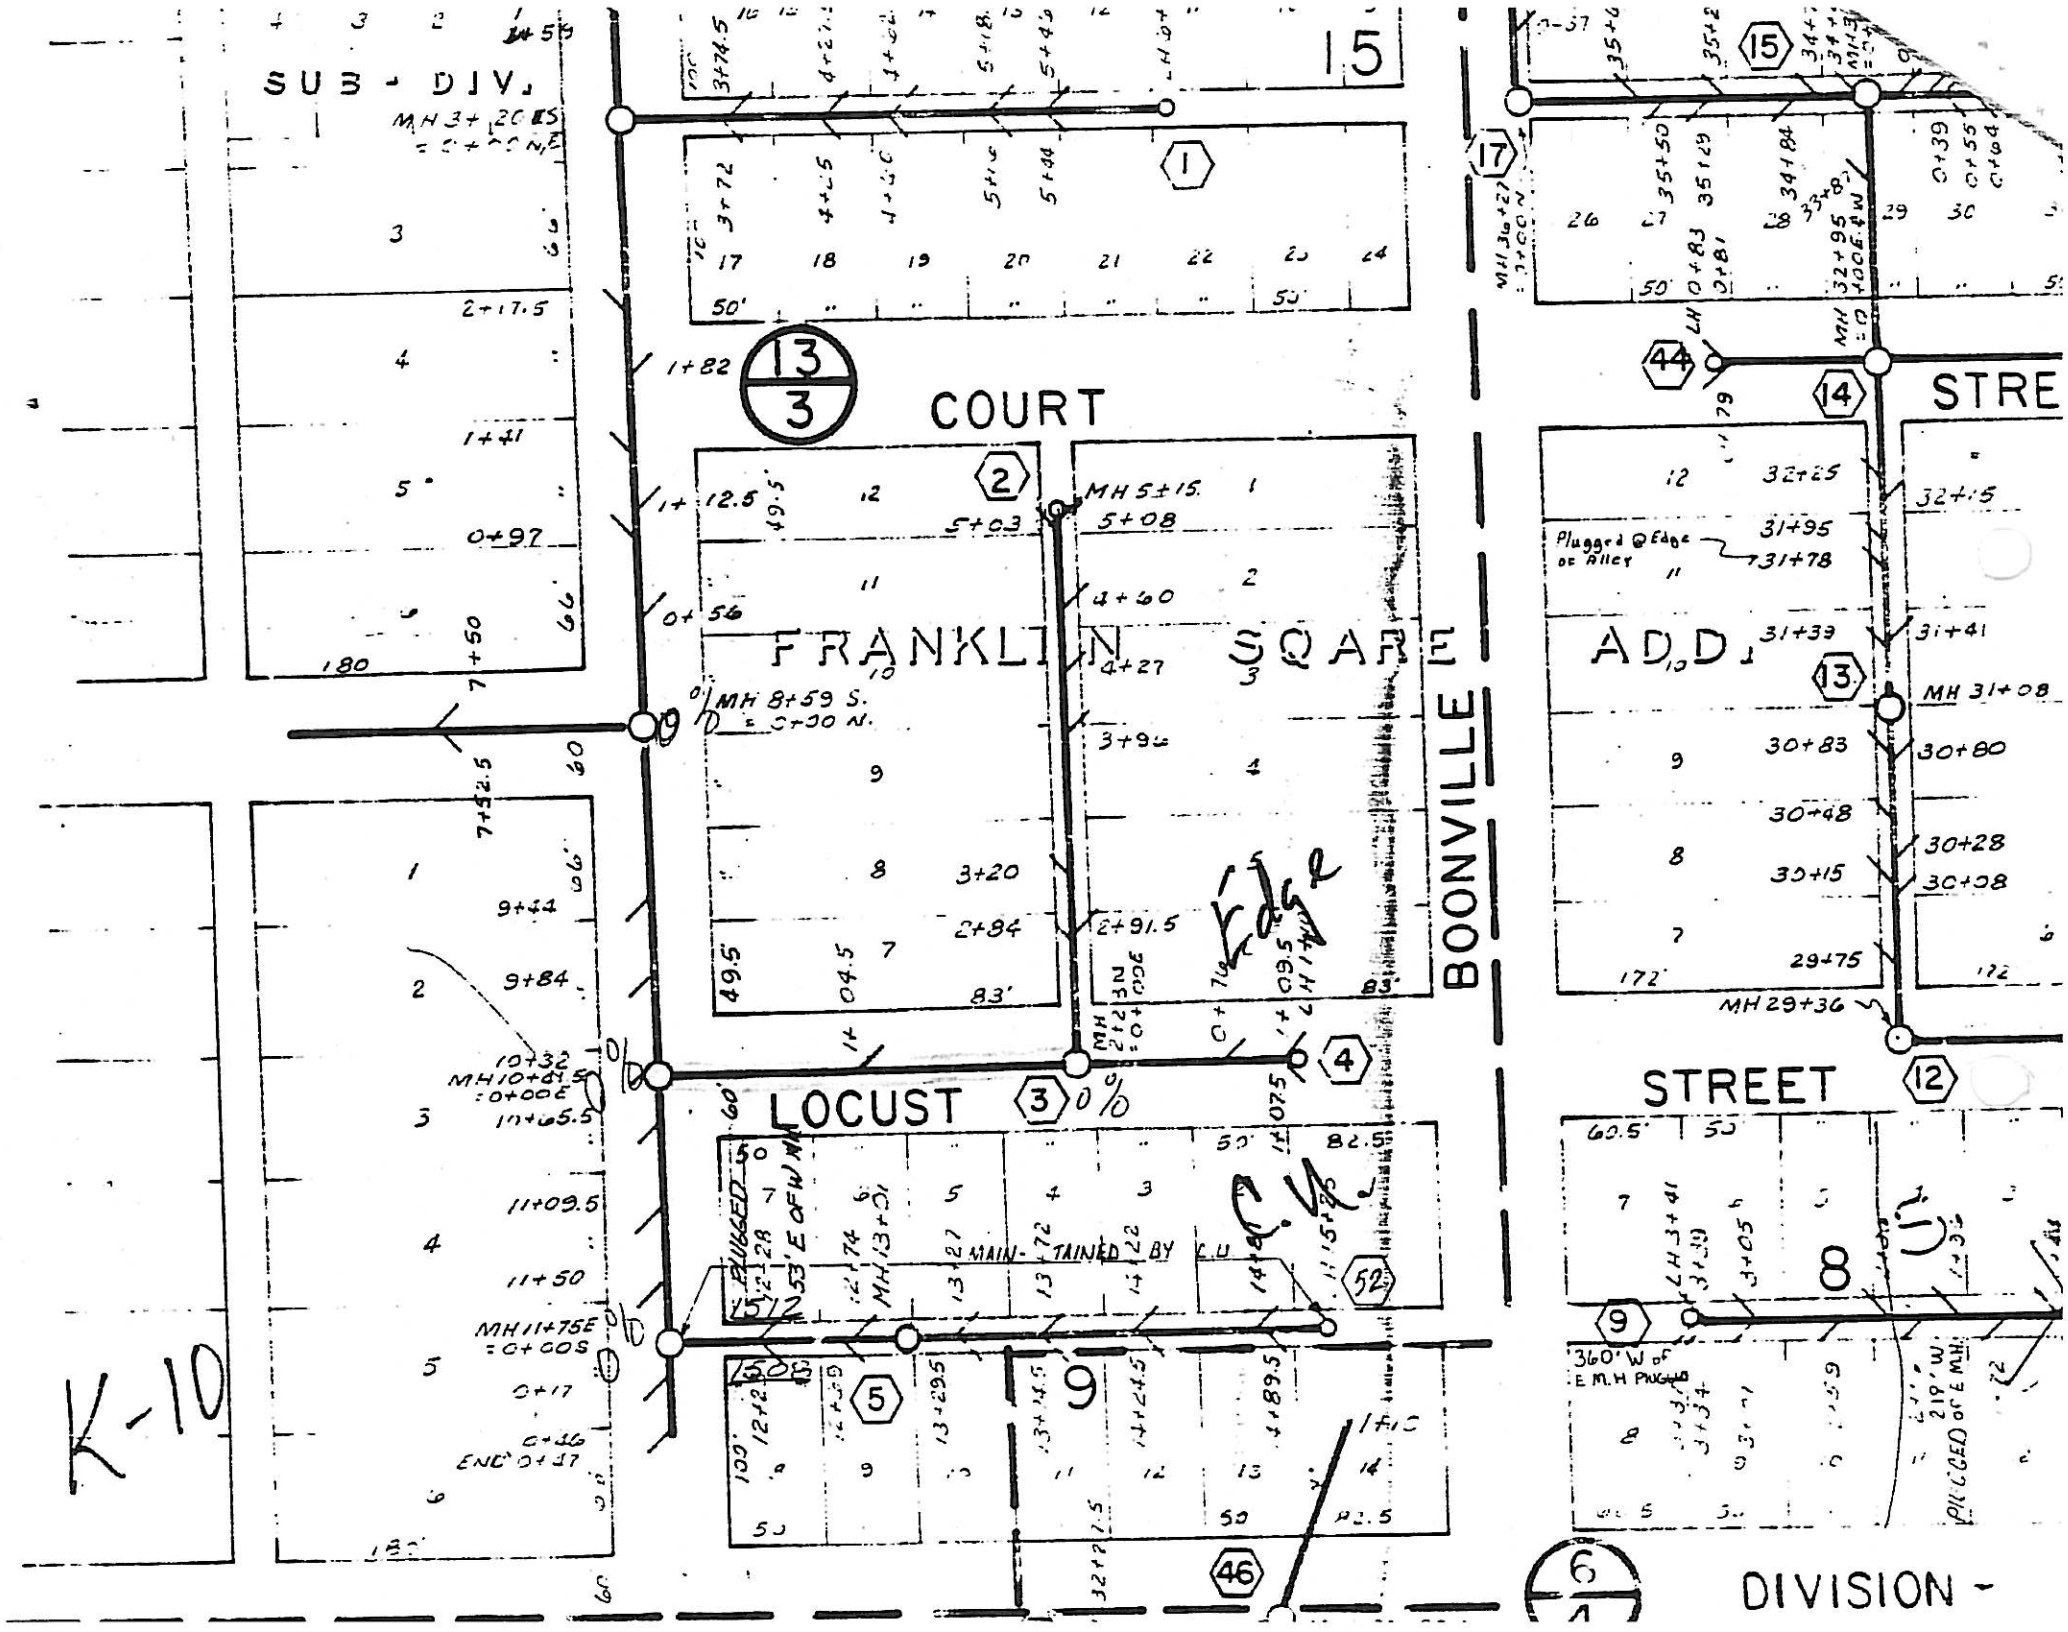

SUB - DIV.
COURT
FRANKLIN SQARE ADD.
BOONVILLE
LOCUST
STREET
STRE
DIVISION -
MAIN-TAINED BY C.U.
Plugged @ Edge of Alley
MH 5+15
MH 8+59 S. = 0+00 N.
MH 31+08
MH 29+36
MH 11+75E = 0+00S
Edge
C.U.
K-10