CITY OF SPRINGFIELD
INTER-OFFICE MEMORANDUM

ATTENTION OF MEMO TO FILE DATE April 23, 1980

DEPARTMENT

Re: Diesel Spill at Nu-Way Emulsion, 3156 East Division.

At 8:15 A.M. Wednesday, April 22, 1980, this office was alerted, by the Fire Department dispatcher, that a 5,000 gallon diesel fuel spill had occured at Nu-Way Emulsion. Upon investigation it was found that a valve on a 5,000 gallon diesel fuel tank had been opened by vandals. After opening the valve on the storage tank they turned on all the water valves that they could.

Nu-Way has a large catch basin to contain any spill that they might have. This basin has a drain pipe, with a valve on it, to drain any rainfall that it might contain. The vandals also opened the valve on the drain pipe in Nu-Ways catch basin. Nu-Way did not have any of their valves locked. The diesel left Nu-Way property and traveled South down a dry drainage ditch along Frisco Railroads right-of-way. The ditch then turns west and flows through a brushy, wooded area and eventually into a sinkhole. Some of the diesel did make it to the sinkhole.

Nu-Way cleaned up all of the diesel fuel that they could, by either pumping out of the ditch back into their catch basin or by picking it up with buckets and putting it into barrels. What they could not get this way, they put straw on to absorb it. The manager for Nu-Way Emulsion is Larry Shoemaker.

3156 EAST DIVISION

SIGNED Gene Pabst
Gene Pabst
Water Pollution Control Inspector III

CITY OF SPRINGFIELD
INTER-OFFICE MEMORANDUM

ATTENTION OF FILE

DATE February 24, 1981

DEPARTMENT

On Monday, February 23rd, Mr. Bill Meese called from Nu-Way Emulsions. He stated that all clean up operations around their lagoon area had been completed.

Upon inspection (8:30 A.M., Tuesday, February 24th) I found that the area had been cleaned of all the previous spill materials.

J.D.

SIGNED J. D. Slaughter
Water Pollution Control Inspector II

3156 E. Division

CITY OF SPRINGFIELD, MISSOURI
SOUTHWEST WASTEWATER TREATMENT PLANT
LABORATORY ANALYSIS REQUEST

DATE IN: 7/1/76

SAMPLE DESCRIPTION AND PHYSICAL APPEARANCE: NuWay Emulsions

CHECK ANALYSIS DESIRED:

_____ SUSPENDED SOLIDS _____ mg/1 Date: _____

_____ BOD_5 _____ mg/1 Date: _____

_____ COD _____ mg/1 Date: _____

_____ pH _____ Date: _____

_____ NH_3-N _____ mg/1 Date: _____

_____ PO_4 ORTHO _____ mg/1 Date: _____

_____ CARBON C_T _____ C_I _____ C_0 _____ Date: _____

_____ TOXICITY _____ Date: _____

_____ HEAVY METALS(SPECIFY): _____

_____ Date: _____

✓ OTHER(SPECIFY): Oil & Grease - 5780 mg/l Date: _____

REPORT OUR: Date: 7/8/76

By: J. Adams

3156 E. Division

CITY OF SPRINGFIELD, MISSOURI
SOUTHWEST WASTEWATER TREATMENT PLANT
LABORATORY ANALYSIS REQUEST

DATE IN: 7-1-76

SAMPLE DESCRIPTION AND PHYSICAL APPEARANCE: Nuway Emulsions

CHECK ANALYSIS DESIRED:

SUSPENDED SOLIDS 150 mg/1 Date:

BOD_5 2825 mg/1 Date:

COD 16 200 mg/1 Date:

pH 8.68 Date:

NH_3-N mg/1 Date:

PO_4 ORTHO mg/1 Date:

CARBON C_T 3325 C_I 57 C_O 3268 Date:

TOXICITY Date:

HEAVY METALS(SPECIFY):

Date:

OTHER(SPECIFY): Oil + grease

5780 mg/l Date:

REPORT OUR: Date: 7-15-76

By: John

3156 E. Division

CITY OF SPRINGFIELD, MISSOURI
SOUTHWEST WASTEWATER TREATMENT PLANT
LABORATORY ANALYSIS REQUEST

DATE IN: 7/1/76

SAMPLE DESCRIPTION AND PHYSICAL APPEARANCE:

NULWAY EMULSIONS

CHECK ANALYSIS DESIRED:

✓ SUSPENDED SOLIDS 150 mg/l Date:

✓ BOD_5 2825 mg/l Date:

✓ COD 16200 mg/l Date:

✓ pH 8.68 Date:

NH_3-N mg/l Date:

PO_4 ORTHO mg/l Date:

✓ CARBON C_T 3325 C_I C_O 3268 Date:

TOXICITY Date:

HEAVY METALS(SPECIFY):

Date:

✓ OTHER(SPECIFY): Oil + grease to follow

Date:

REPORT OUR: Date: 7/7/76

By: J. Adams

3156 E. Division

CITY OF SPRINGFIELD, MISSOURI
DEPARTMENT OF PUBLIC HEALTH AND WELFARE
GENERAL SANITATION SECTION

Date July 1, 1976

Time _____ A.M., _____ P.M.

Lab. No. Misc. (Sani. Serv.)

Sealed ( ) Unsealed (X)
Official (X) Unofficial ( )

(Fill in this space if illness occurred)

No. persons ill _____ Symptoms _____

Time of ingestion _____
Time of onset of symptoms _____

Sample submitted by:

Name John T. Witherspoon - Sanitary Services

Address _____, Missouri

Sample of _____ Perishable ( ) Non-perishable ( )

Condition of sample on arrival : Satisfactory ( ) Unsatisfactory ( ) Iced ( )

Name of Manufacturer (If not same as above) NuWay Emulsions #19

Address _____, Missouri

Reason for analysis _____

TESTS TO BE RUN:

Chemical & Physical - - - Common Poisons ( ), Federal Standards ( ), Insects (Eggs & Larvae) ( ), Insect fragments ( ), Sulphites ( ), Preservatives ( ) Starches or cerals ( ), Filth ( ), Other ( ), _____

Bacteriological - - - - -
Total Count ( ), Coliform ( ), Other Inhibition on B. Subtillus

Fe, Zn, Cu, Cr, Pb Inhibition

Sample received by

LABORATORY RESULTS & CONCLUSIONS: Analyst _____ Date 7-2-76

Fe = 9.0 ppm
Zn = <.5 ppm
Cu = <.1ppm
Cr = <.1ppm
Pb = .1ppm
Positive for inhibition = Trace .05 units

(Use back for additional information)

3156 E. Division

City Hall
830 Boonville Avenue
Springfield, Missouri 65802
417-865-1611

February 17, 1976

Mr. L.A. Peck
Riffe Petroleum Company
Philtower Building
Tulsa, Oklahoma 74103

SUBJECT: EARTHEN DYKES AND STORAGE TANKS
NU-WAY EMULSIONS
3156 EAST DIVISION

Dear Mr. Peck:

Plans for the dyke for the subject project have been reviewed and approved by the various departments at City Hall. I have checked the records to see if permits have been issued for the existing tanks on the job. There have been no permits issued; therefore, it will be necessary that you or someone from your company secure the permits for construction of these features. I have talked to Bill Porter at the job site and told him that he will need to get the proper building permits.

If you have any questions, please let me know.

Very truly yours,

DEPARTMENT OF BUIDLING REGULATIONS

Jerry King

Jerry King, P.E.
Structural Engineer

JK:qh
cc: Harry Criswell
Sanitary Services

Fire Department

Building Inspector

3156 E. DIVISION

#736 BUILDING REGULATIONS 2-4-76

Time In: _____ Time Out: _____

Approved: _____
Signed

STRUCTURAL ENGINEER

Time In: _____ Time Out: _____

Approved: _____
Signed

SANITARY SERVICES 10:40 (1 copy)

Time In: 2-10-76 Time Out: _____

Approved: _____
Signed

TRAFFIC ENGINEER

Time In: _____ Time Out: _____

Approved: _____
Signed

Dike

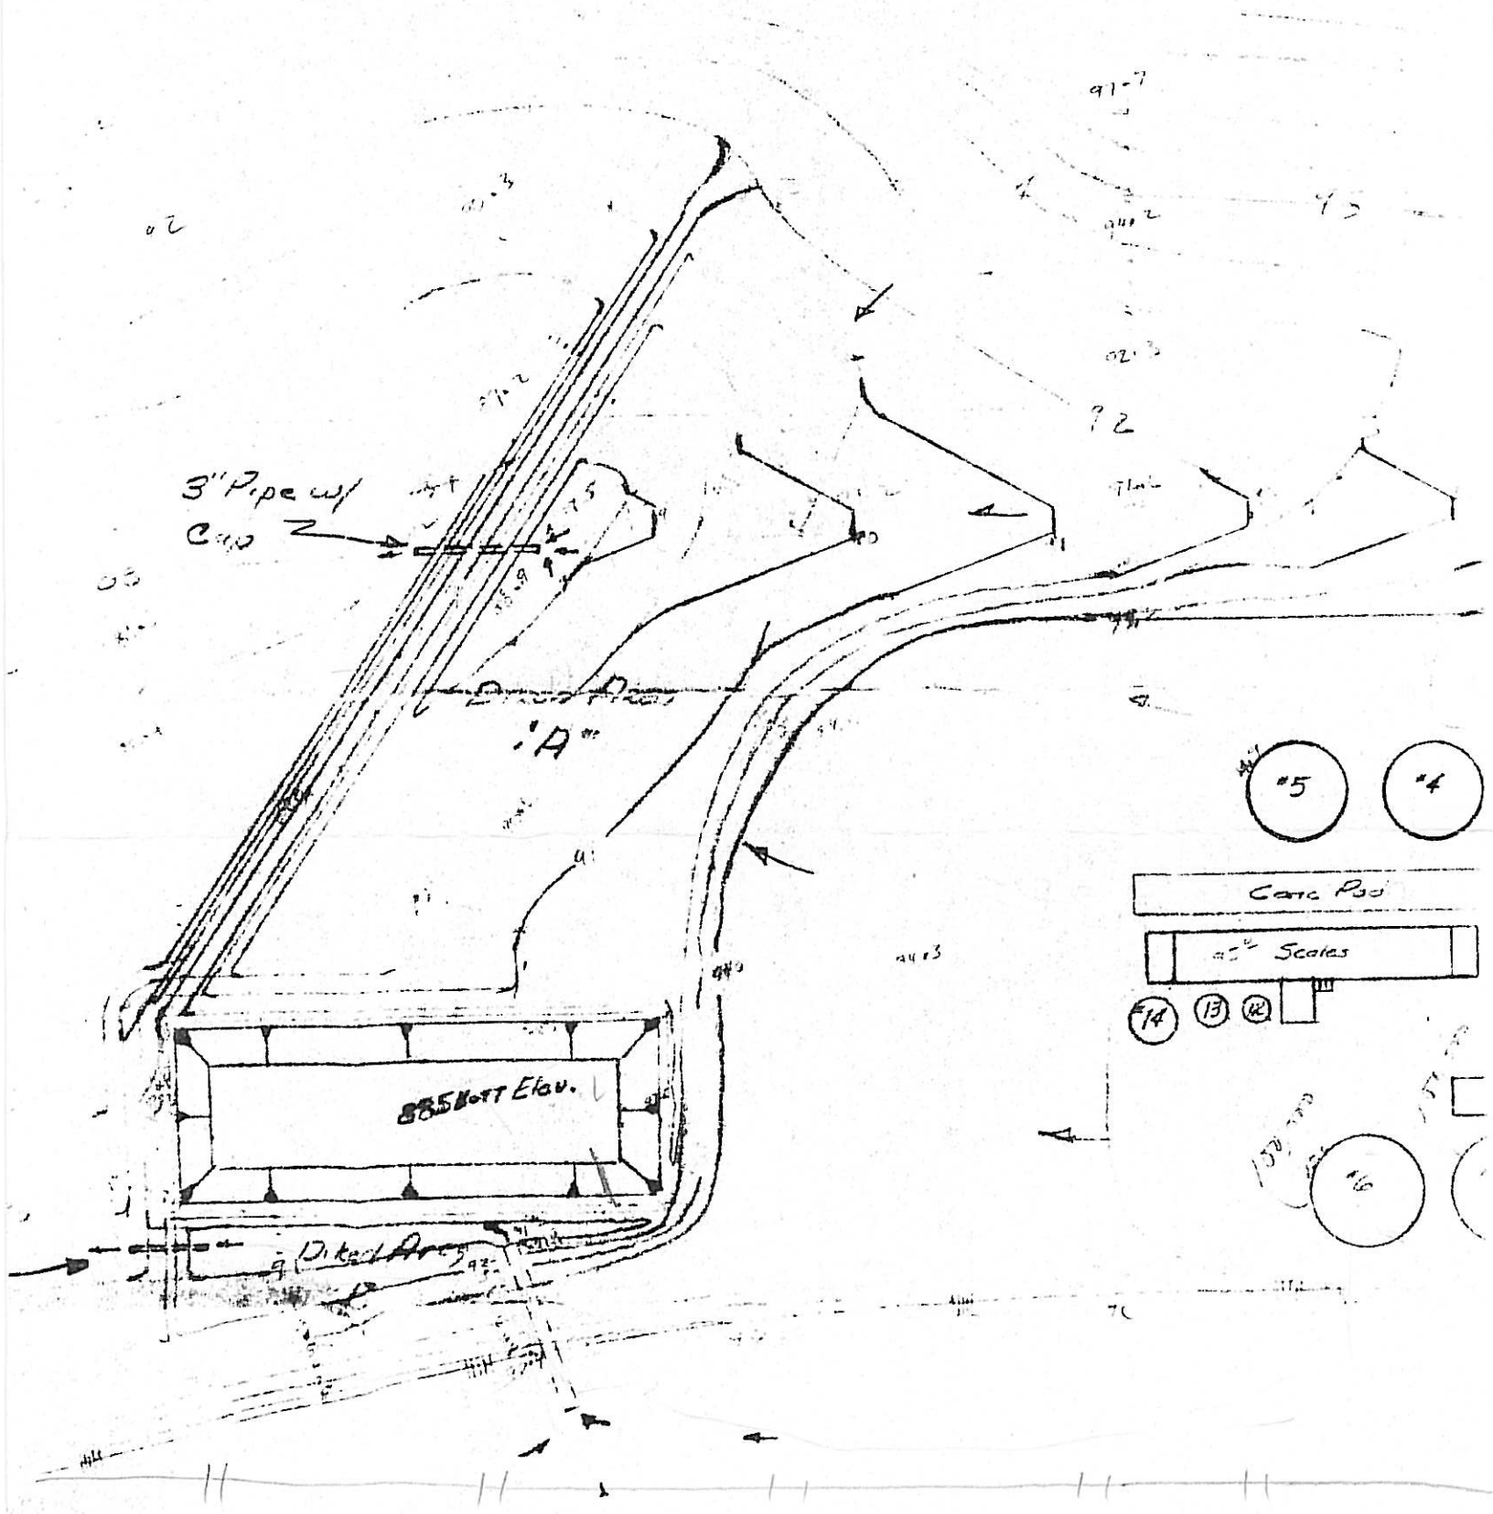

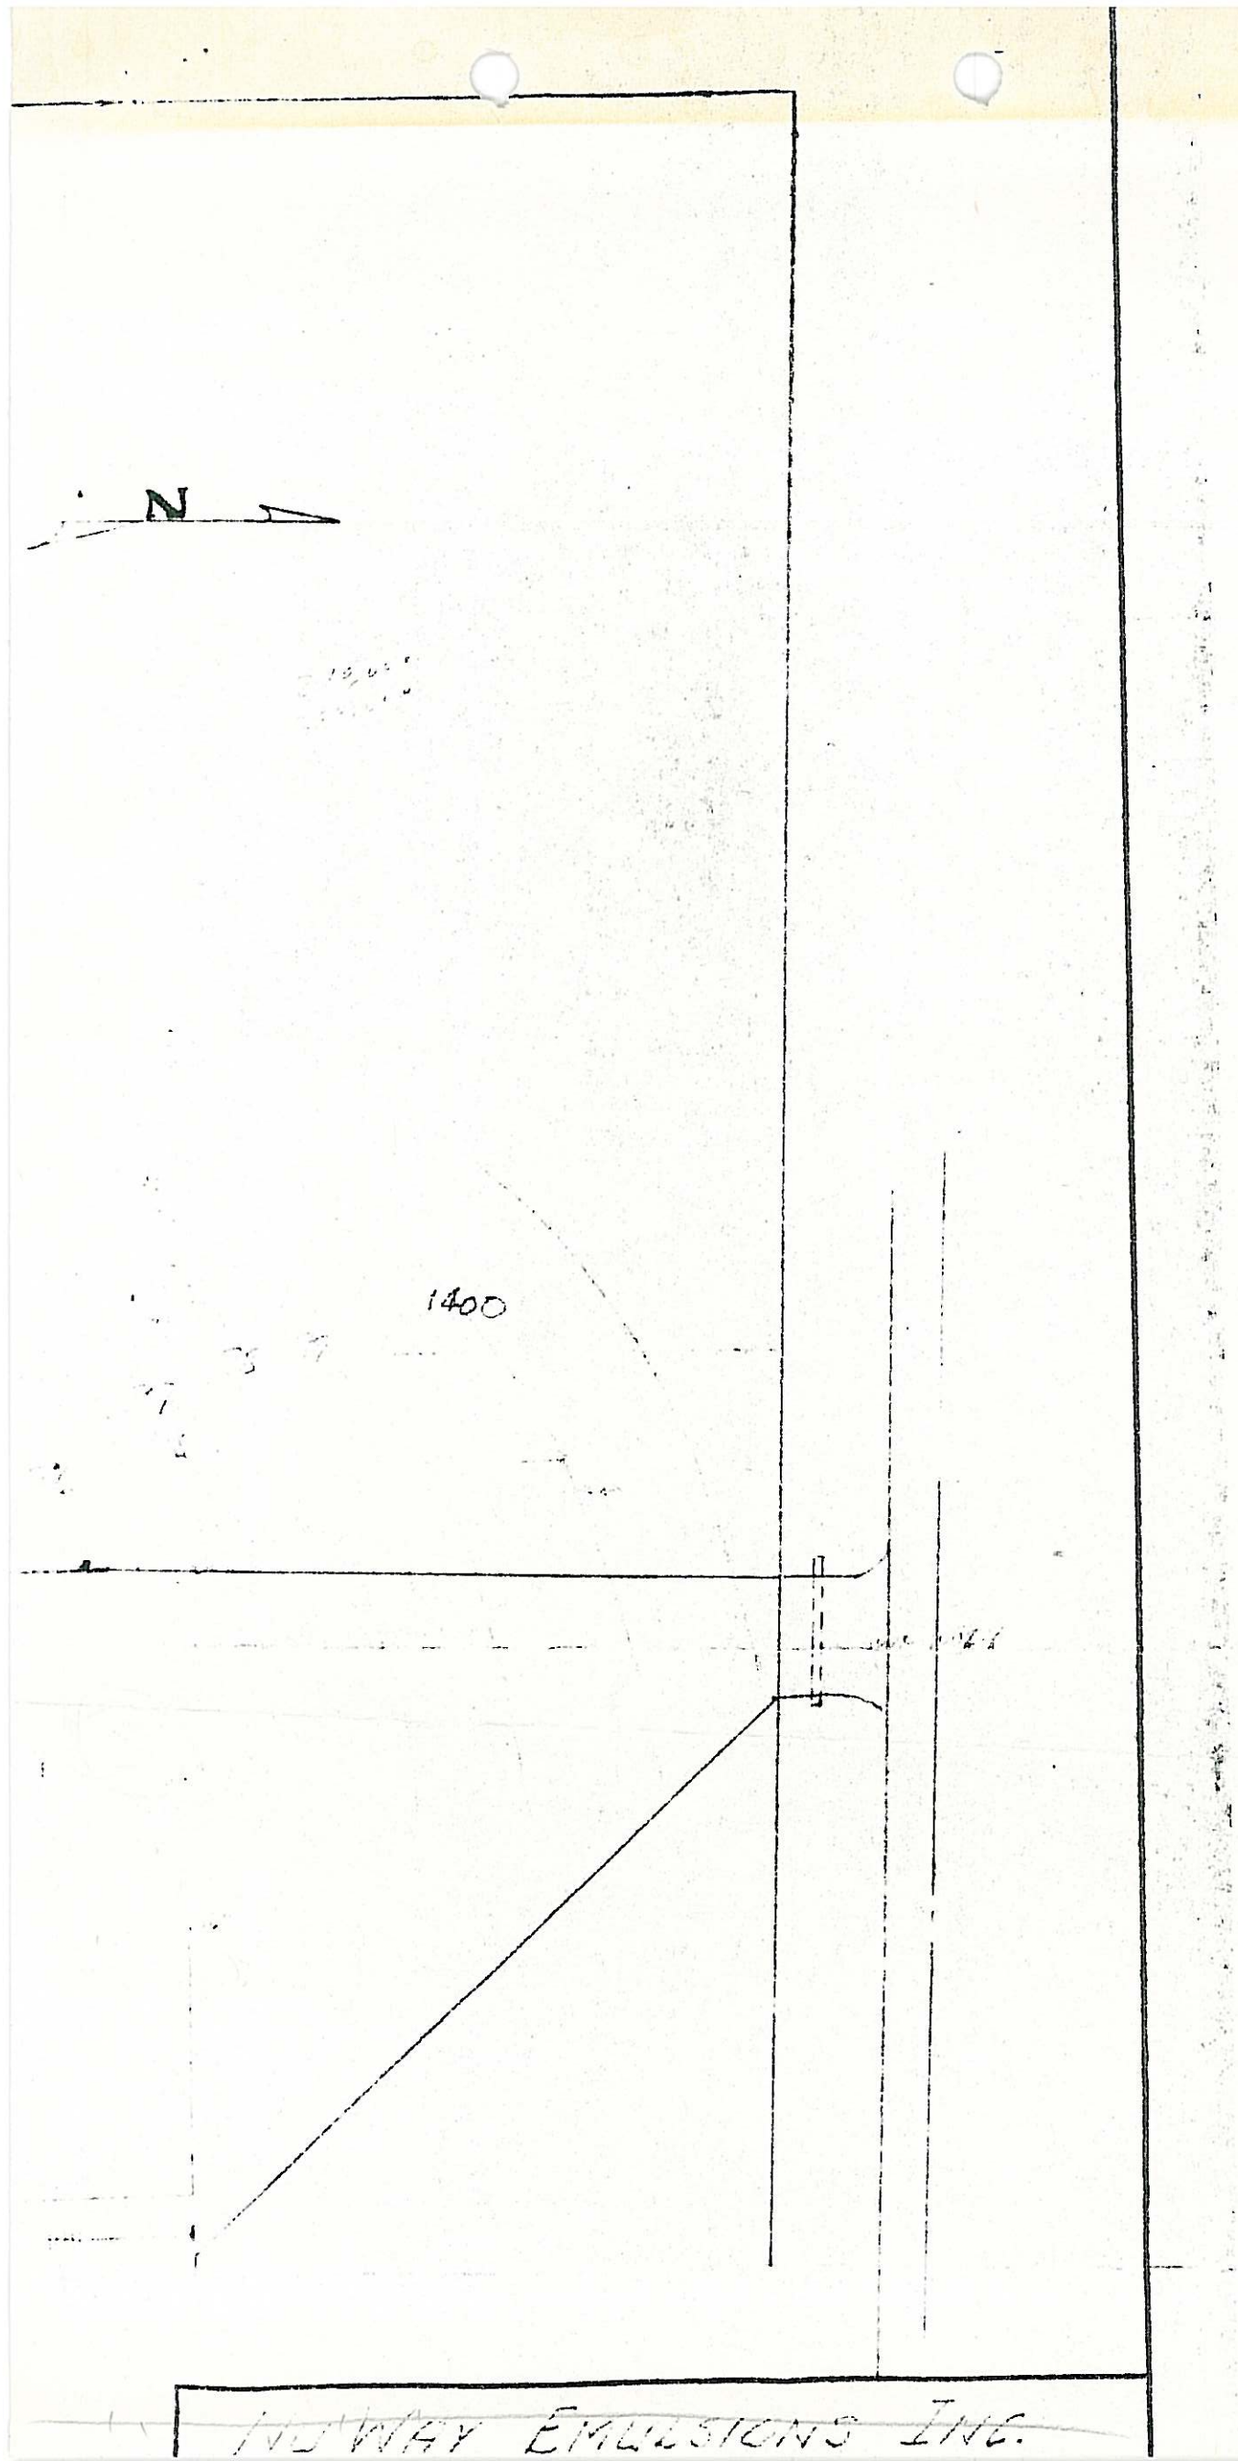
N
1400
NORWAY EMULSIONS INC.

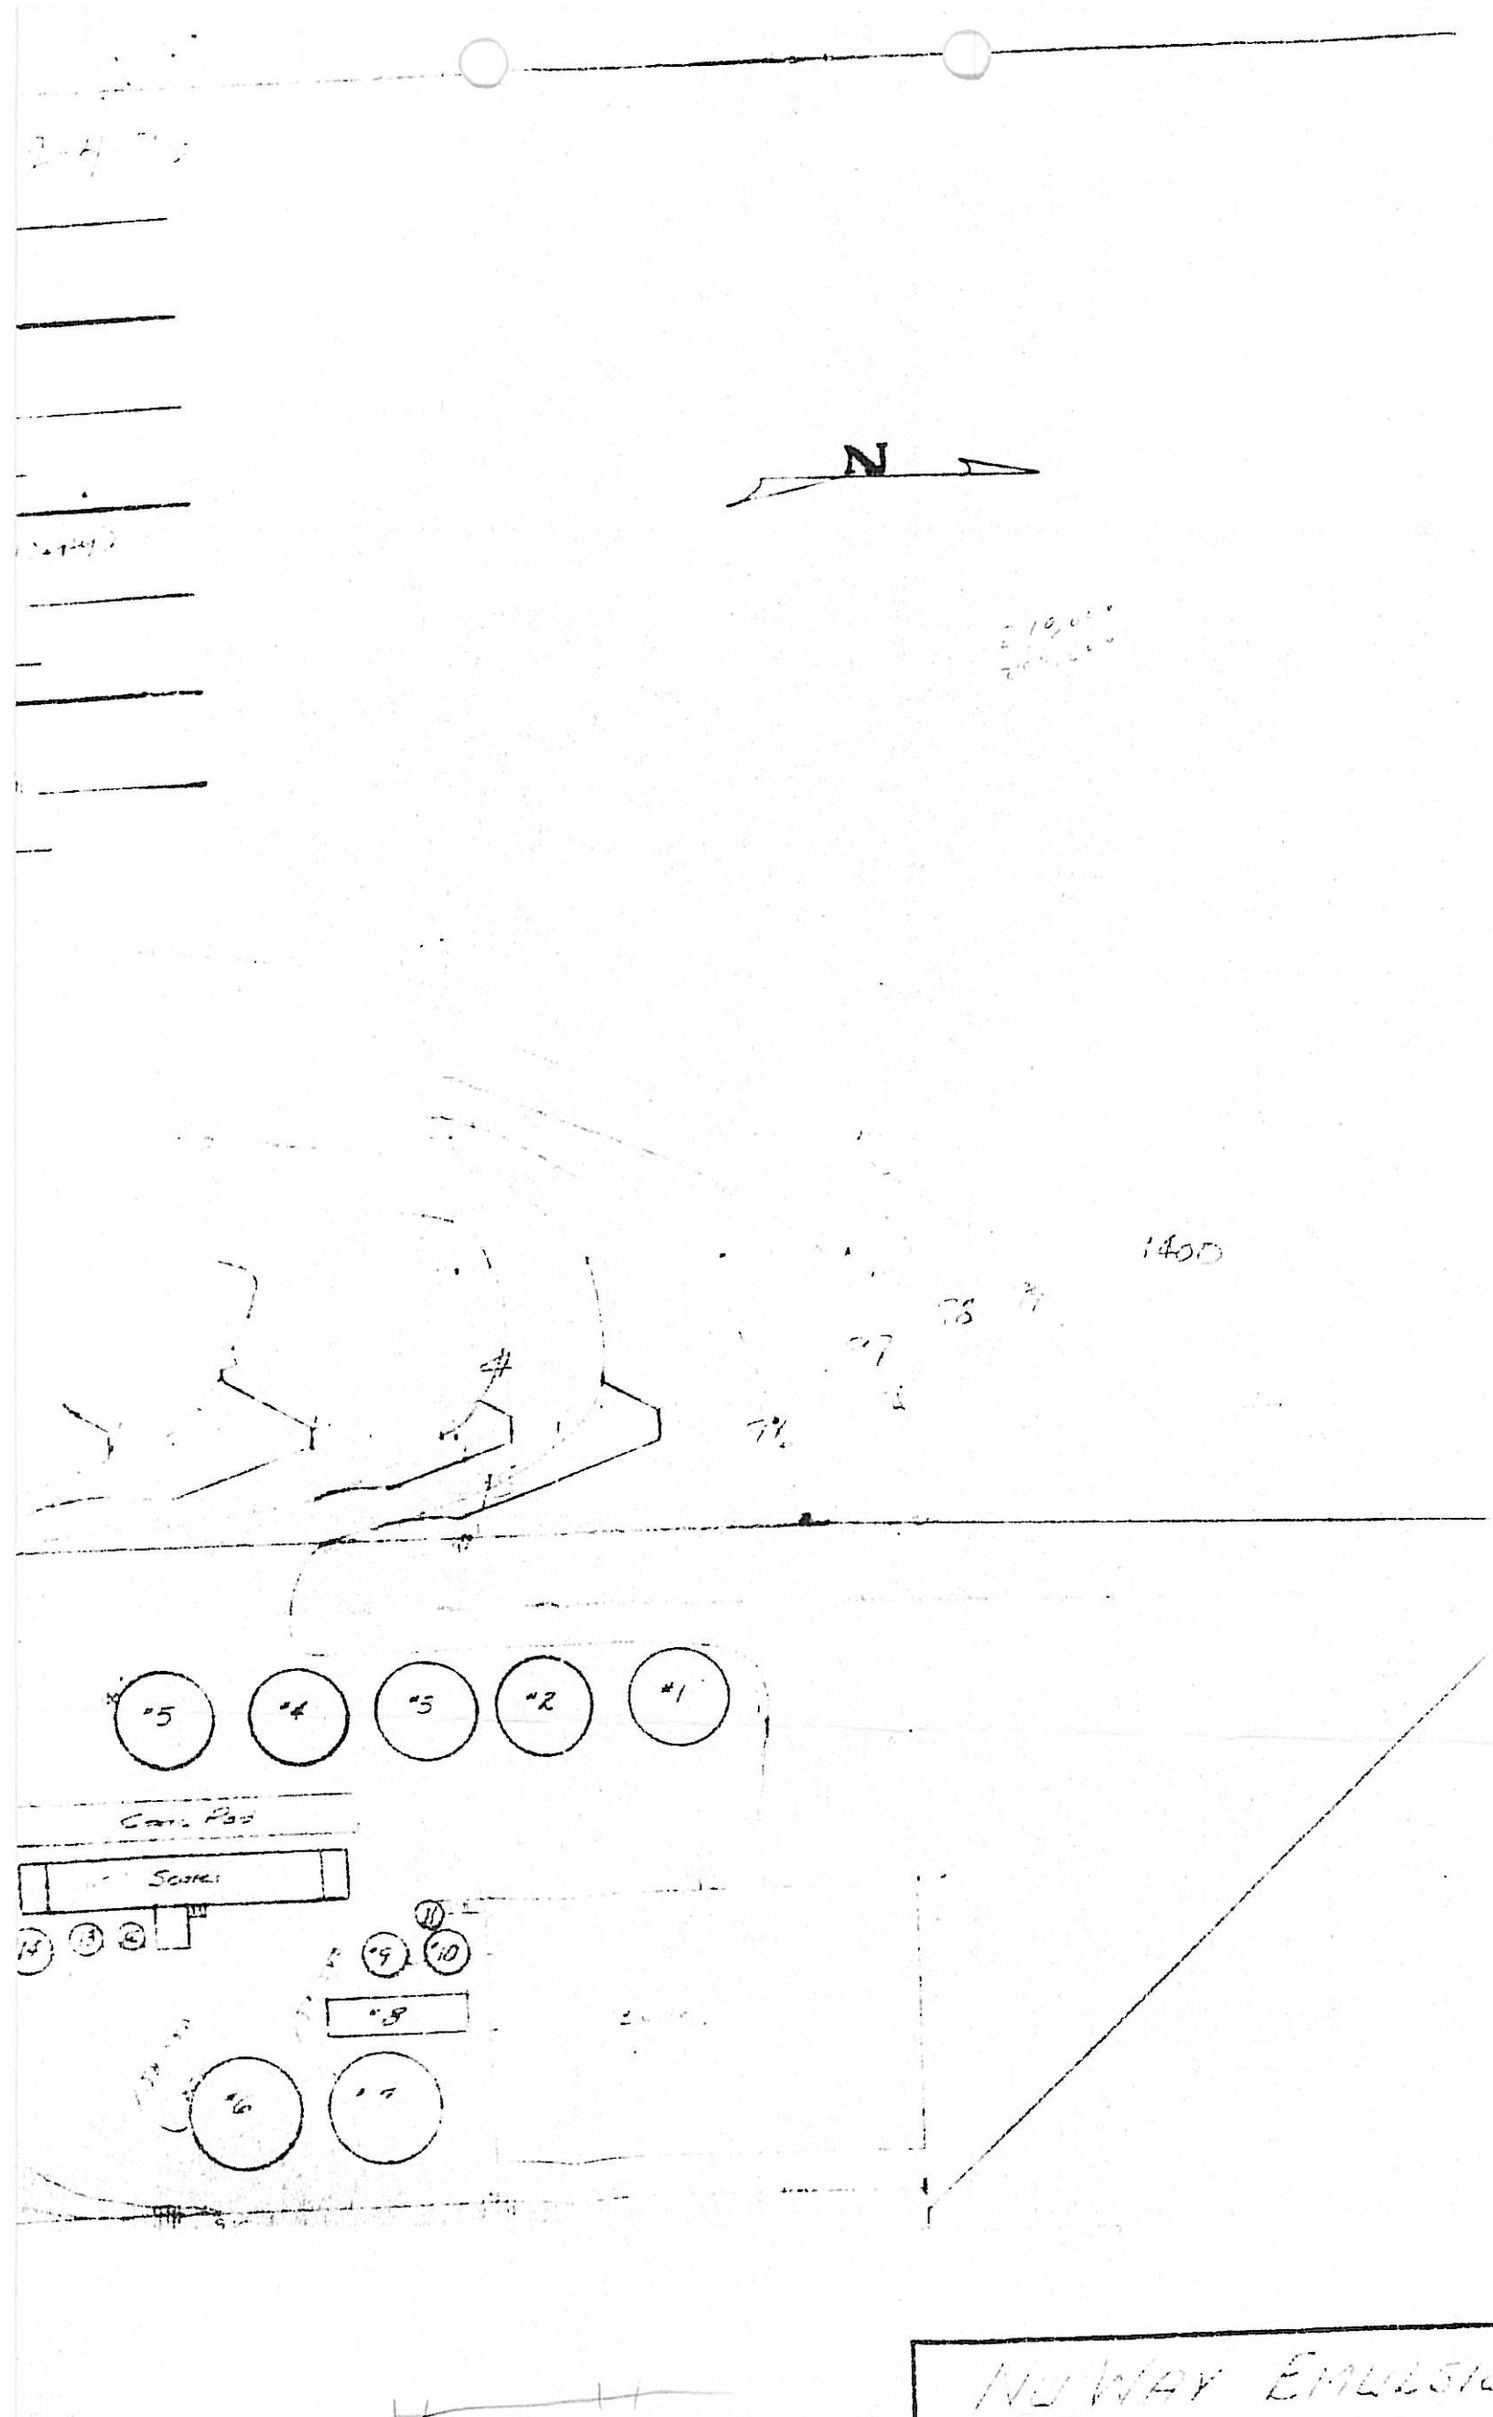
N
1400
#5
#4
#3
#2
#1
Scales
#9
#10
#8
#6
#7
NUWAY EMULSIO
APPROVED BY: